

QE-CURRENT-485 | QE-CURRENT-485-H



Visit the product page  
for news, updates and downloads



QE-CURRENT-485



QE-CURRENT-485-H

**CONTENTS**

Product overview	3
Available versions	3
Inputs	4
Outputs	4
Communication interface	4
Reports and alerts	4
Technical specifications	5
Electrical characteristics	5
Available measurements	5
Measurement accuracy	6
Communication characteristics	6
General data	7
Order codes	7
Connection and installation	8
RS485 bus termination	9
Example of how to use a current transducer	10
Status LEDs	10

Product features	11
Modbus	11
Inputs/output	11
Status LEDs	11
Digital input alarm	11
Device configuration	12
Dip-switch Modbus RTU address and baud rate setting	12
Functionality configuration	12
Q-WIZARD	12
Third-party Modbus Master	13
Function 03 Hexadecimal (Read Holding Registers)	13
Function 06 Hexadecimal (Write Single Holding Register)	14
Function 10 Hexadecimal (Write Multiple Registers)	15
Register map	16



## SAFETY WARNINGS AND CAUTIONS

The following warnings and cautions must be observed to ensure personal safety and prevent damage.



**Death** or **serious injury** may result from failure to heed this warning.



It is necessary to comply with national regulations when installing and picking materials for power lines.



**Material damage** or **serious personal injury** may result from failure to heed this warning.



Repairs and modifications must be carried out only by the manufacturer. It is forbidden to open the case and make any changes to the device. Tampering with the device will invalidate the warranty.



The manufacturer **declines all responsibility** for electrical safety in the event of improper use of the equipment.



It is essential to read the entire contents of this manual before carrying out any work.



The product described in this document may only be used for the specified application. The maximum performance data and environmental conditions specified in the product data sheet must be observed. Proper transport and storage, as well as professional assembly, installation, handling and maintenance are required for the correct and safe operation of the device.



Before commissioning, make sure that:

- the maximum values for all connections are not exceeded; refer to the product data sheet;
- the connection cables are not damaged or live during wiring;
- the direction of current flow and phase rotation are correct.

Use under ambient conditions other than those specified, application of signals or voltages other than those specified, may cause significant deviations from the specified measurement tolerances, which may be irreversible.

During installation, ensure that a switch or circuit-breaker is near the product and easily accessible.



Although the contents of this document have been checked for accuracy, it may contain errors or inconsistencies and we cannot guarantee its completeness or accuracy.

The unit must be uninstalled if safe operation can no longer be guaranteed (e.g. visible damage). Disconnect all connections in this case. The unit should be returned to the manufacturer or to an authorised service centre for repair.



This document is subject to periodic revision and updating. QEED reserves the right to make changes to the product and/or its technical documentation at any time in the interests of continuous quality improvement. Always consult the latest version of the documentation available on the website:



**WARNING:** High-intensity magnetic fields may alter the values measured by the transformer. Avoid installation near: permanent magnets, electromagnets, or iron masses. If irregularities are detected, reposition or move the unit to a more suitable location.

[www.qeed.it](http://www.qeed.it)

If you find any errors or missing information in this document, please notify us by e-mail to:

[technical@qeed.it](mailto:technical@qeed.it)



Failure to observe the warnings may result in damage to the equipment or failure to operate as intended.



Disposal of waste electrical and electronic equipment (applicable in the European Union and other countries with separate collection). The symbol on the product or its packaging indicates that the product should not be treated as household waste. Instead, it will be handed over to an authorised collection point for the recycling of electrical and electronic waste. Ensuring that the product is disposed of properly will prevent potential negative effects on the environment and human health, which could otherwise be caused by inappropriate waste management of the product. Recycling materials helps to conserve natural resources. For further information, please contact your local authority, waste disposal service or the retailer from whom you purchased the product.



Please note that the information on the nameplate must be observed.





**PRODUCT OVERVIEW**

The QE-CURRENT-485 is a current transducer (and analyzer in the -H version) capable of interfacing with various isolated current transducers, with both current and voltage outputs, also suitable for reading 2- or 3-wire PT100 or NTC temperature probes, as well as non-characterized probes by entering the STEINHART-HART curve in the Q-WIZARD configuration software.

Different types of input signal measurement are available depending on the product version.

An analogue output and a digital output (configurable dry contact) are also provided.

Power/error/communication/output status LEDs are on the front of the case.


RS485 serial interface for communication with Modbus RTU protocol, either from the **Q-WIZARD configuration tool**, or with third party Modbus masters by acting on register map registers.

Possibility of FW update with special software (on request).

Ready for DIN rail mounting with T-BUS terminal (optional) for fast connection with hot insertion/removal option.

**Available versions**

- **QE-CURRENT-485:** current converter for current transducers with current/voltage outputs, analogue output and RS485 Modbus RTU serial interface; RMS, AC and DC minimum, average and maximum measurements; frequency and crest factor measurement; temperature or resistance measurement
- **QE-CURRENT-485-H:** current converter and analyser for current transducers with current/voltage outputs, analogue output and RS485 Modbus RTU serial interface. Same measurements as the basic version with the addition of harmonic analysis up to the 63rd, THD, I peak and measurement of the module's internal temperature (to understand the cabinet temperature)

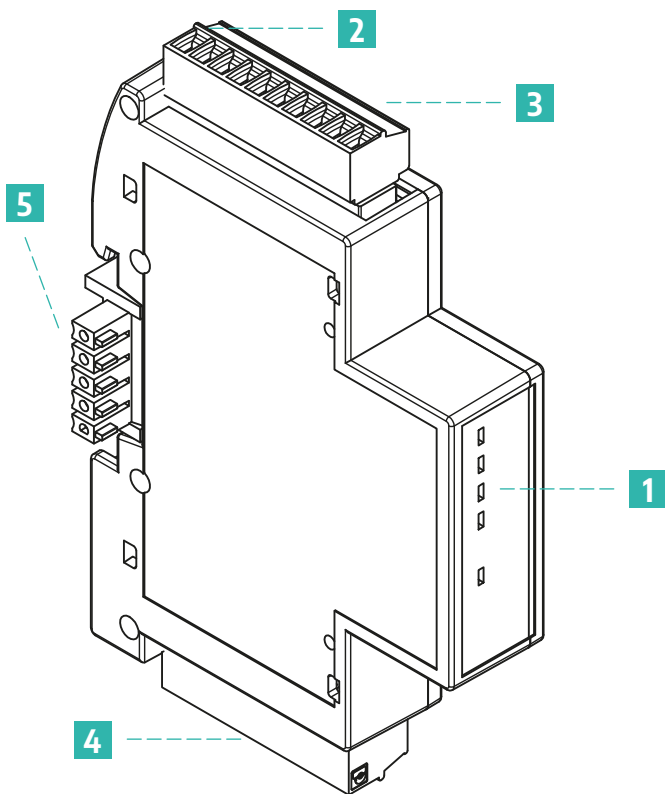

- 1 Status LEDs
- 2 Power supply terminals
- 3 Output terminals
- 4 Input terminals
- 5 T-BUS terminal for both power supply and Modbus RTU communication (optional)



## Inputs

- **Programmable (non-isolated) current:**
  - ROGOWSKI coil
  - Current transformer with 1A or 5A secondary
  - Current/voltage transformer with  $\pm 10\text{Vpk}$  or  $\pm 1\text{Vpk}$  secondary
  - Current transducer with secondary 100mA AC/DC
  - Configurable\* HALL sensor with its own power supply ( $\pm 15\text{VDC}$ ) up to 10A AC/DC

**WARNING:** Do not use for direct measurements via shunt.
- **Temperature:** PT100 (PT-385) 2-3 fili or NTC (10k $\Omega$ , 100k $\Omega$  or by entering STEINHART-HART coefficients)

## Outputs

- **Voltage:** configurable\* 0-10V, 2k $\Omega$  minimum load resistance
- **Current:** configurable\* 0-20mA, 600 $\Omega$  maximum load resistance
- **Alarm contact:** optoMOS (NA - 1 form-B) for alarm or pulse retransmission for totalisation, configurable via programming software or via RS485 using Modbus RTU registers

## Communication interface

- **RS485 Modbus RTU:** connection to RS485 serial bus on module base via adapter (T-BUS optional) or terminals. Front dip-switch for manual setting of address and baud rate

\* Via the **Q-WIZARD configuration software** or dedicated registers

## Reports and alerts

The device notifies the user of the following faults via the LED interface:

- EEPROM problem on the configuration microprocessor (module out of order, configuration lost)
- Input signal above/below threshold
- RTD out of range
- Third RTD wire not connected

These anomalies can also be associated with digital output as alarms.

In addition, the digital output can also be associated with an alarm on the input measurement reported at the output; depending on the configuration software setting, the output contact can be set as NC or NO.



## TECHNICAL SPECIFICATIONS

### Electrical characteristics

Power supply	10÷30 V <sub>DC</sub> Reverse polarity and overheating protected
Current consumption	250mA max
Temperature input	Precision ±1°C - PT100 (PT-385) 2-3 wire - NTC (10kΩ, 100kΩ customizable with STEINHART-HART coefficients)
Current input	- ROGOWSKI coil - Current transformer with 1A or 5A secondary - Current/voltage transformer with ±10V <sub>pk</sub> or ± 1V <sub>pk</sub> secondary - Current transformer with 333mV secondary - Current transducer with secondary 100mA AC/DC - HALL sensor with its own power supply (±15V <sub>DC</sub> )
Outputs	- Voltage: configurable* 0-10V, 2kΩ minimum load resistance - Current: configurable* 0-20mA, 600Ω maximum load resistance - Digital (optoMOS NA, 1-form-B, 30V, <50mA)
Communication Interface	RS485 Modbus RTU
Visual Interface	Status LEDs
Sampling rate	Variable: equal to 128 * Freq <sub>network</sub> in the range 9-70Hz Fixed: equal to 6400 samples/s outside the above range
Analog output accuracy	0,1% F.S.
Temperature coefficient	< 100ppm/°C

### Available measurements

	Model	
	QE-CURRENT-485	QE-CURRENT-485-H
I <sub>rms</sub> min – med – MAX	✓	✓
I <sub>dc</sub> min – med – MAX	✓	✓
I <sub>ac</sub> min – med – MAX	✓	✓
Charge amount (Ah) I <sub>rms</sub> – I <sub>dc</sub> – I <sub>ac</sub>	✓	✓
Frequency	✓	✓
Crest Factor	✓	✓
Temperature (PT100/NTC)	✓	✓
Resistance RTD/NTC	✓	✓
THD		✓
I <sub>picco</sub>		✓
Harmonic analysis up to the 63rd harmony		✓
Internal microcontroller temperature		✓



## Measurement accuracy



1 or 5A Channel	Crest factor 4 (relative to 5A)		
	Range: 50mA < I < 250mA	Maximum reading error: 1%	
	Range: 250mA < I < 5A	Maximum reading error: 0,5%	
	Thermal drift	<100 ppm/°c	
	Passband (-3dB)	>2 kHz	
20 or 100mA Channel	Crest factor 4 (relative to 100mA)		
	Range: 1mA < I < 5mA	Maximum reading error: 1%	
	Range: 5mA < I < 100mA	Maximum reading error: 0,5%	
	Thermal drift	<100 ppm/°c	
	Passband (-3dB)	>2 kHz	
±1V <sub>pk</sub> Channel	Range: 10mV < V < 50mV	Maximum reading error: 1%	
	Range: 50mV < V < 1V	Maximum reading error: 0,5%	
	Thermal drift	<100 ppm/°c	
	Passband (-3dB)	>2kHz	
±10V <sub>pk</sub> Channel	Range: 100mV < V < 500mV	Maximum reading error: 1%	
	Range: 500mV < V < 10 V	Maximum reading error: 0,5%	
	Thermal drift	<100 ppm/°c	
	Passband (-3dB)	>800 Hz	
PT100 Channel	Range	-200°C ÷ 600°C	
	Error	± 1.2°C on reading	
	Thermal drift	<100 ppm/°C	
NTC Channel	Range	200Ω ÷ 20kΩ	20kΩ ÷ 300kΩ
	Error	±1.2°C on reading	±1.6°C on reading
	Thermal drift	<100 ppm/°C	

## Communication characteristics



Protocol	Modbus RTU
Baudrate	1200 ÷ 115200 bps (default 9600)
Addresses	1 ÷ 247 (default 1)
Data format	1 start bit, 8-bit data, NO/ODD/EVEN parity (default NO parity)
Response delay	1 ÷ 1000ms
Connection	Via removable terminal, T-BUS or microUSB



**General data**

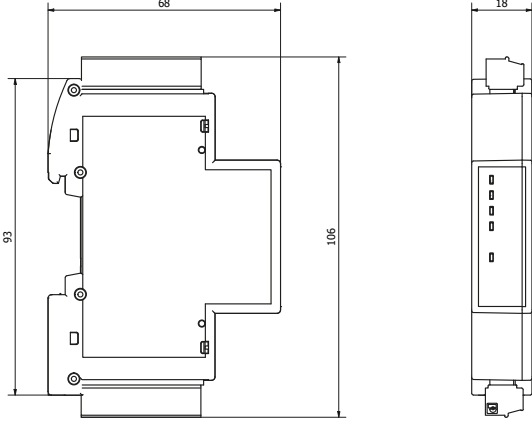Working temperature	-15÷60° C
Storage temperature	-40÷85° C
Relative humidity	10÷90% not condensing
Elevation	Up to 2000m a.s.l.
Protection degree	IP20
Measurements	106x68x18 mm 
Weight	60 g
Terminal cable cross-section	0.05÷1.5 mm <sup>2</sup> (30÷14 AWG)
Energy values storage	Flash, min 100k writings
Approvals and certifications	EN61000-6-3; EN61000-4-2; EN61000-4-3; EN61000-4-4; EN61000-4-5; EN61000-4-6; EN61010-1 
Installation	Inside electrical panels and mounted on a DIN rail

**Order codes**


Converter	QE-CURRENT-485
Converter and analyzer	QE-CURRENT-485-H
T-BUS	 QA-TBUS-17,5 width 17,6mm  QA-TBUS-22 width 22,6mm



## CONNECTION AND INSTALLATION

The instrument is designed to be installed inside electrical panels and mounted on a DIN rail, with or without the aid of the T-BUS connector for interfacing multiple instruments with reduced cabling.

All connection terminals are shown on the pad print on the product and correspond to the figure below:

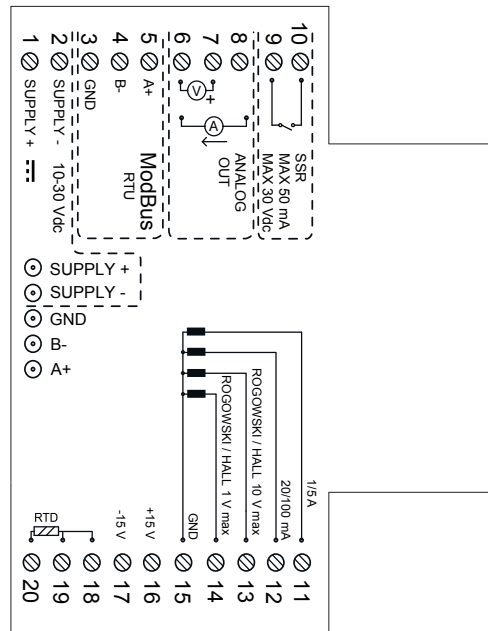

The functionality of the terminals is described below:

<p>2 ⓪ SUPPLY - 10-30 Vdc 1 ⓪ SUPPLY + </p>	<p>Device power supply. <b>Please note:</b> Wiring must be protected against short circuits and/or accidental faults</p>
	<p>Sensors and transducer inputs Depending on the type of sensor or signal available, follow the connections as shown in the circuit diagram</p> <ul style="list-style-type: none"> <li>• 1 or 5A sensor: between terminals 11 and 15 (GND)</li> <li>• 20 or 100mA sensor: between terminals 12 and 15 (GND)</li> <li>• ±10V max. probes: between terminals 13 and 15 (GND)</li> <li>• ±1V max. probes: between terminals 14 and 15 (GND)</li> <li>• PT100 2-wire/NTC probes: 18, 19 (<b>by jumpering these two terminals together</b>) and 20</li> <li>• 3-wire PT100 probes: between terminals 18, 19 and 20 (without jumper between terminals 18 and 19)</li> </ul> <p><b>Hall sensor power supply</b> Dual power supply for a Hall sensor (external), either +15V or -15V (MAX 50mA), is available from terminals 16 (positive) and 17</p> <p><b>WARNING:</b> Do not use for direct measurements via shunt.</p>
<p>10 ⓪  RELAY 9 ⓪  MAX 50 mA MAX 30 Vdc</p>	<p>Digital output the output is a dry contact (OptoMOS NA, 1-form-B, 30V, &lt;50mA). The contact can be used as an alarm contact (the associated parameter can be set via configuration software)</p>
<p>8 ⓪  ANALOG 7 ⓪  OUT 6 ⓪ </p>	<p>Analogue output For analogue voltage output, connect terminals 6 (negative) and 7 (positive). For the active current analogue output, connect terminals 8 (I<sub>out</sub>) and 6 (I<sub>in</sub>)</p>



<p>5  A+      <b>ModBus</b> 4  B-                      <b>RTU</b> 3  GND</p>	<p>RS485 serial interface: available on terminals 3 (GND), 4 (B-), 5 (A+) or via accessory T-BUS accessory (optional) to be placed at the bottom of the board</p>
<p> SUPPLY +  SUPPLY -  GND  B-  A+</p>	<p>T-BUS interface connection (requires optional T-BUS accessory): the T-BUS accessory can be fitted to the module base to provide both power supply and serial communication (see figure below). The number of modules supported by the bus depends on the power supply used (please check the power consumption of the modules)</p>

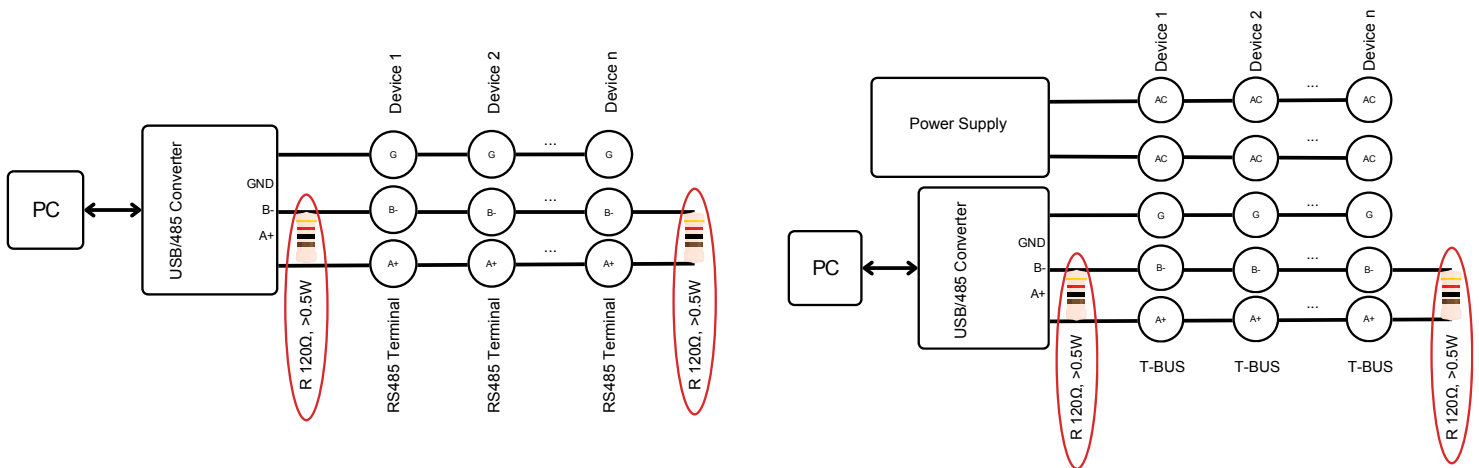


**Figure 1:** DIN-rail installation with T-BUS

**RS485 bus termination**

To avoid unbalances on the transmission bus, it is advisable to insert a termination resistor at the beginning of the RS-485 bus (typically on the USB-RS485 adapter) and at the end (typically on the last slave - which can also be activated by dip-switch). It is advisable to use 120Ω resistors with 1% tolerance, which corresponds to the typical impedance of RS485 cables.

The following images are for illustrative purposes only:



**Figure 2:** RS485 dynamic bus termination



### Example of how to use a current transducer

Depending on the transducer used and the current that has to be measured in the installation, it might be useful to make more than one turn around the transducer's core in order to have the sensed current at the centre of the data acquisition instrument scale. In this case accordingly change the transformer ratio acting on reg. 40009.



Normal installation - 1 turn  
(1 conductor's crossing through core)



2 turns  
(2 conductor's crossing through core)



4 turns  
(4 conductor's crossing through core)

Figure 3: turns examples

### STATUS LEDS

Function	Status	Meaning
Power (green)	ON	Powered device
Comm (yellow)	ON	Presence of one or more module anomalies/errors (configurable via <b>Q-WIZARD</b> or via dedicated registers - see page 16) The LED flashes when the bootloader is loaded
RX (red)	Flashing	The system is receiving data from the RS485
TX (red)	Flashing	The system is transmitting data on RS485
D <sub>out</sub> (green)	ON	Active digital output



## PRODUCT FEATURES

The following functions can be configured using the configuration software or the dedicated registers:

### Modbus

Address, baud rate, parities and stop bits are adjustable.

### Inputs/output

- Activation of the ampere-hour flash storage [Reg. 40007].
- Selection of the type of current input used [Reg. 40007] and related settings (transformer ratio [Reg. 40009], minimum sensed current [Reg. 40011], number of tenths of seconds (in DC) [Reg. 40013] or steps to zero (in AC) [Reg. 40014] for RMS current calculation (the higher the number, the slower and more accurate the calculation), update time for max, [Reg. 40015 - 40023] (if set to 0, the value is not averaged and absolute values are taken for max. and min. values)
- Signal type reported on output channel [Reg. 40007]
- Voltage/current output selection [Reg. 40007]
- Input and output signal range setting [Reg. 40025 - 40031]
- Harmonic analysis type: absolute/relative to first harmonic (-H version) [Reg. 40007]
- THD calculation (-H version) [Reg. 40007]
- Temperature probe type selection [Reg. 40007]

### Status LEDs

By adjusting register [40008], it is possible to set a fault signal to be displayed via the Fail LED on the front of the device.

### Digital input alarm

It is possible to define the threshold and hysteresis of the value that determines the activation of the alarm associated with the digital output by editing registers [40024, 40039 and 40041].


Finally, by accessing register [40007], it is possible to select whether an alarm is to be activated above/below the set threshold, with a lower/upper hysteresis, corresponding respectively to a NO or NC contact at start-up of the instrument.



## DEVICE CONFIGURATION

### Dip-switch Modbus RTU address and baud rate setting

The baud rate can be changed using the DIP switch on one of the two sides of the module. If DIP1 is set to zero, the module adopts the configuration from the EEPROM, otherwise it adopts the configuration set by the DIP switch according to the table:

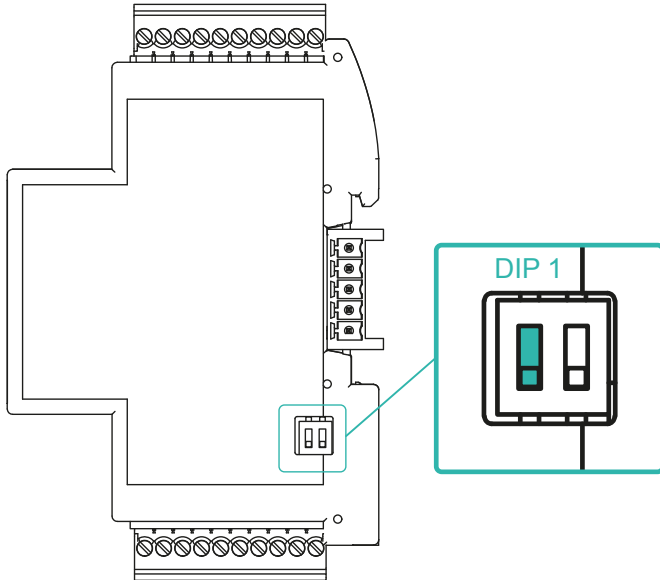

DIP1	DIP2	Baudrate	Address
0	x	EEPROM	EEPROM
1	0	9600	1
1	1	38400	1

Figure 4: Baud rate configuration dip-switch

Addresses other than 1 (default) or baud rates other than those shown in the table can be configured using the **Q-WIZARD** configuration software or the Modbus RTU functions below by acting on the dedicated registers.

### Functionality configuration

It is possible to connect to the product via an RS485 serial device, such as our Q-USB485, or via the microUSB port.

If the microUSB is used for configuration only, the main power supply from the terminals is not necessary, but it must be present to have all the functions active (real-time monitoring); if configuration is made from the terminals, the power supply must always be present.

The configuration of the module can be done with our **Q-WIZARD** configuration tool or with any third-party Modbus master, by acting on the registers of the card - see page 16.

### Q-WIZARD

Using the **Q-WIZARD interface tool (downloadable from here)** all device parameters can be configured by following the simple, intuitive steps.

In addition to the configuration of various parameters, inputs and outputs, the **Q-WIZARD** also allows real-time monitoring of device variables.



### Third-party Modbus Master

Alternatively, the product can communicate directly with a third-party Modbus RTU Master using the communication settings according to the DIP switch configuration (when using microUSB the DIP switch settings are irrelevant).

The communication protocol supported is Modbus RTU Slave:

- Modbus RTU connections: A+ and B- according to Modbus RTU standards
- Supported Modbus RTU functions: 03 hexadecimal (read multiple registers, max 100), 06 hexadecimal (write single), 10 hexadecimal (write multiple registers)
- Modbus RTU address numbering is by convention '1 BASED' (standard), but the physical register is base 0; the logical address, e.g. 40010, corresponds to the physical address #9, as required by Modbus RTU standards

**PLEASE NOTE:** All setting changes of calibration and configuration parameters must be followed by the flash save command 0xC1C0 = Flash settings save command in register 40328; changes of device communication parameters in addition must also be followed by the command 0xC1A0 = Reboot command in register 40328.

In this case, all device configurations are performed by accessing the Modbus RTU register map available in the last chapter of this document using the functions:

- Read holding registers (function 03 hexadecimal)
- Write single holding register (function 06 hexadecimal)
- Write multiple registers (function 10 hexadecimal)

### Function 03 Hexadecimal (Read Holding Registers)

This function is used to read the contents of a contiguous block of holding registers (words). The request frame specifies the source register address and the number of registers to read. A maximum of 120 registers (words) can be read with a single request, unless otherwise specified. The register data in the response message is packaged as two bytes per register (word), with the binary contents right-justified within each byte. For each register, the first byte contains the most significant bits (MSB) and the second byte contains the least significant bits (LSB).

Request Frame			
Description	Length	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	
Function code	1 byte	03 HEX	
Starting address	2 bytes	0000 to FFFF HEX	Bytes order: MSB, LSB
Number of registers (N word)	2 bytes	1 to 10 HEX (1 to 16)	Bytes order: MSB, LSB
CRC	2 bytes		

Response frame (right action)			
Description	Length	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	
Function code	1 byte	03 HEX	
Required Number of bytes	1 byte	N word * 2	
Register value	N*2 bytes		Bytes order: MSB, LSB
CRC	2 bytes		

Response frame (wrong action)			
Description	Length	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	Possible exception: 01: illegal function 02: illegal data address 03: Illegal data value 04: Slave device failure
Function code	1 byte	83 HEX	
Exception code	1 byte	01, 02, 03, 04 (see note)	
CRC	2 bytes		



### Function 06 Hexadecimal (Write Single Holding Register)

This function is used to write a single holding register. The request frame specifies the address of the register (word) to be written and its contents. The correct response is an echo of the request, returned after the contents of the register have been written.

Request frame			
Description	Lenght	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	
Function code	1 byte	06 HEX	
Starting address	2 bytes	0000h to FFFF HEX	Bytes order: MSB, LSB
Register value	2 bytes	0000h to FFFF HEX	Bytes order: MSB, LSB
CRC	2 bytes		

Response frame (right action)			
Description	Lenght	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	
Function code	1 byte	06 HEX	
Starting address	2 bytes	0000h to FFFF HEX	Bytes order: MSB, LSB
Register value	2 bytes	0000h to FFFF HEX	Bytes order: MSB, LSB
CRC	2 bytes		

Response frame (wrong action)			
Description	Lenght	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	Possible exception: 01: illegal function 02: illegal data address 03: Illegal data value 04: Slave device failure
Function code	1 byte	86 HEX	
Exception code	1 byte	01, 02, 03, 04 (see note)	
CRC	2 bytes		



**Function 10 Hexadecimal** (Write Multiple Registers)

This function is used to write a block of contiguous registers (maximum of 2). The required values to be written are specified in the data field of the request. The data is packed as two bytes per register.

A correct response returns the function code, the starting address and the number of registers written.

Request frame			
Description	Lenght	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	
Function code	1 byte	10 HEX	
Starting address	2 bytes	0000 to FFFF HEX	Bytes order: MSB, LSB
Number of registers (N word)	2 bytes	0001 to 0078 HEX	Bytes order: MSB, LSB
Byte counting	1 byte	N word * 2	
Register value	N * 2 bytes	value	Bytes order: MSB, LSB
CRC	2 bytes		

Response frame (right action)			
Description	Lenght	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	
Function code	1 byte	10 HEX	
Starting address	2 bytes	0000 to FFFF HEX	Bytes order: MSB, LSB
Number of registers (N word)	2 bytes	0001 to 0078 HEX	Bytes order: MSB, LSB
CRC	2 bytes		

Response frame (wrong action)			
Description	Lenght	Value	Comments
Physical address	1 byte	1 to F7 HEX (1 to 247)	Possible exception: 01: illegal function 02: illegal data address 03: Illegal data value 04: Slave device failure
Function code	1 byte	90 HEX	
Exception code	1 byte	01, 02, 03, 04 (see note)	
CRC	2 bytes		



## REGISTER MAP

Default values are in **bold**.

## ONLY QE-CURRENT-H VERSION

Address Modbus	Description	Register Type	R/W	Default
40001	Machine ID: 15 = QE-CURRENT-485 25 = QE-CURRENT-485-H	UShort [16b]	R	
40002	Hardware (MSB) and Firmware (LSB) Revision	UShort [16b]	R	
40003	Modbus address	UShort [16b]	R/W	1
40004	Modbus communication response delay (in machine cycles)	UShort [16b]	R/W	1
40005	Baudrate Value: 0 = 1200 1 = 2400 2 = 4800 <b>3 = 9600</b> 4 = 19200 5 = 38400 6 = 57600 7 = 115200	UShort [16b]	R/W	3
40006	Parity: <b>0 = None</b> 1 = Odd 2 = Even	UShort [16b]	R/W	0
40007	Measurement settings: bit[0] = Ah saved in flash <b>0 → Ah disabled</b> 1 → Ah enabled bit[1..2] = Current transducer type <b>0 → Input 1A or 5A</b> 1 → Input 20 mA or 100 mA 2 → Input 1 V 3 → Input 10 V bit[3] = RTD measurement (don't care if bits [9,10] are not both set to zero) 0 → 2 wire RTD <b>1 → 3 wire RTD</b> bit[4] = Analogue output type 0 → Voltage 0-10 V <b>1 → Current 0-20 mA</b> bit[5..6] = Measurement available on analogue output <b>0 → IRMS</b> 1 → Iac 2 → Ioc 3 → Temperature bit[7] = FFT representation <b>0 → Absolute</b> 1 → Relative to the I1 value bit[8] = THD calculation <b>0 → Only AC components</b> 1 → Including DC components bit[9..10] = Temperature sensor <b>0 → PT100</b> 1 → NTC 10 KΩ 2 → NTC 100 KΩ 3 → NTC Steinhart-Hart bit[11..12] = Measurement type <b>0 → Float</b> 1 → Float Swapped 2 → Hundredth (Float * 100) 3 → Hundredth swapped (Float * 100 SW) bit[13] = Integrator condition <b>0 → Integrator disabled</b> 1 → Integrator enabled (Rogowski input) bit[14] = Digital output alarm type 0 → active below threshold <b>1 → active above threshold</b> bit[15] = Measurement filtering <b>0 → Disable</b> 1 → Enable	UShort [16b]	R/W	16408



Address Modbus	Description	Register Type	R/W	Default
40008	Set the yellow led (COMM LED) according to the corresponding bit set: bit[0] = Fail Eeprom bit[1] = Input Under-range bit[2] = Input Over-range bit[3] = Output Under-range bit[4] = Output Over-range bit[5] = RTD Out of the range <b>bit[6]= RTD Third Wire error</b>	UShort [16b]	R/W	64
40009	Current transformer ratio CT ratio = primary current of transducer / secondary current (or voltage) of transducer / (number of turns - if any) [see figure 03] Example: current transducer QI-KCT-10-50/333 (50A primary, secondary 333mV output), no turns --> CT = 150,1501	Float [32b-LSW]	R/W	1
40011	Minimum Current Ripple: Threshold under which the instrument reads 0 independent from the input value	Float [32b-LSW]	R/W	0
40013	DC filter: Update interval for RMS calculation. Valid for DC systems. [tenths of a second].	UShort [16b]	R/W	10
40014	AC filter: Number of line period for RMS calculation. Valid for AC systems. (example: 50 → if frequency is 50Hz, updated every 1s)	UShort [16b]	R/W	50
40015	Seconds for average RMS: Seconds for the calculation of average RMS value (min 0 – max 30)	UShort [16b]	R/W	0
40016	Seconds for MAX RMS: Seconds for the calculation of MAX RMS value (min 1 – max 30). If the value is 0, then the absolute MAX RMS is given.	UShort [16b]	R/W	0
40017	Seconds for min RMS: Seconds for the calculation of min RMS value (min 1 – max 30). If the value is 0, then the absolute min RMS is given.	UShort [16b]	R/W	0
40018	Seconds for average DC: Seconds for the calculation of average DC value (min 0 – max 30)	UShort [16b]	R/W	0
40019	Seconds for MAX DC: Seconds for the calculation of MAX DC value (min 1 – max 30). If the value is 0, then the absolute MAX DC is given.	UShort [16b]	R/W	0
40020	Seconds for min DC: Seconds for the calculation of min DC value (min 1 – max 30). If the value is 0, then the absolute min DC is given.	UShort [16b]	R/W	0
40021	Seconds for average AC: Seconds for the calculation of average AC value (min 0 – max 30)	UShort [16b]	R/W	0
40022	Seconds for MAX AC: Seconds for the calculation of MAX AC value (min 1 – max 30). If the value is 0, then the absolute MAX AC is given.	UShort [16b]	R/W	0
40023	Seconds for min AC: Seconds for the calculation of min AC value (min 1 – max 30). If the value is 0, then the absolute min AC is given.	UShort [16b]	R/W	0
40024	Address of the magnitude to be monitored with the alarm (ex. 40149 I RMS, 40151 I DC, 40153 I AC, ecc)	UShort [16b]	R/W	40149
40025	Low limit of input range: Lower input value of current [A] or temperature [°C] (depending on bits[5,6] of reg. 40007) matched to low value of analogue output (reg. 40027)	Float [32b-LSW]	R/W	0
40027	Low limit of output range: Output value [mV or µA] corresponding to low input value set in reg. 40025	UShort [16b]	R/W	4000
40029	High limit of input range: Higher input value of current [A] or temperature [°C] depending on bits[5,6] of reg. 40007 matched to high value of analogue output (reg. 40031)	Float [32b-LSW]	R/W	5
40031	High limit of output range: Output value [mV or µA] corresponding to high input value set in reg. 40029	UShort [16b]	R/W	20000
40033	Coeff Steinhart-Hart A	Float [32b-LSW]	R/W	0
40035	Coeff Steinhart-Hart B	Float [32b-LSW]	R/W	0
40037	Coeff Steinhart-Hart C	Float [32b-LSW]	R/W	0
40039	Alarm Threshold	Float [32b-LSW]	R/W	0
40041	Alarm Hysteresis	Float [32b-LSW]	R/W	1



Address Modbus	Description	Register Type	R/W	Default
40147	Status: bit[0] = flash settings error; bit[1] = flash calibration error; bit[2] = Current Over Range; bit[3] = Current Under Range; bit[4] = don't care; bit[5] = RTD Open or broken; bit[6] = Current Zero crossing detecting; bit[7] = Switch open; bit[8] = RTD third wire error (Resistance > 20 Ω); bit[9] = RTD out of the range (-200 °C .. + 600 °C) bit[10] = Ah storing error; bit[11] = Analog Output over range; bit[12] = don't care; bit[13] = Alarm detection; bit[14] = Analog Output under range; bit[15] = don't care;	UShort [16b]	R	
40148	Analogue output type (in mV or in uA): 0 = Voltage 0÷10V 1 = Current 0÷20mA	Short [16b]	R	
40149	RMS Value [A]	Float [32b-LSW]	R	
40151	DC value [A]	Float [32b-LSW]	R	
40153	AC value [A]	Float [32b-LSW]	R	
40155	Frequency [Hz]	Float [32b-LSW]	R	
40157	Crest Factor	Float [32b-LSW]	R	
40159	Total Harmonic Distortion	Float [32b-LSW]	R	
40161	DC Harmonic	Float [32b-LSW]	R	
40163	1st Harmonic	Float [32b-LSW]	R	
40165	2nd Harmonic	Float [32b-LSW]	R	
40167	3rd Harmonic	Float [32b-LSW]	R	
40169	4th Harmonic	Float [32b-LSW]	R	
40171	5th Harmonic	Float [32b-LSW]	R	
40173	6th Harmonic	Float [32b-LSW]	R	
40175	7th Harmonic	Float [32b-LSW]	R	
40177	8th Harmonic	Float [32b-LSW]	R	
40179	9th Harmonic	Float [32b-LSW]	R	
40181	10th Harmonic	Float [32b-LSW]	R	
40183	11th Harmonic	Float [32b-LSW]	R	
40185	12th Harmonic	Float [32b-LSW]	R	
40187	13th Harmonic	Float [32b-LSW]	R	
40189	14th Harmonic	Float [32b-LSW]	R	
40191	15th Harmonic	Float [32b-LSW]	R	
40193	16th Harmonic	Float [32b-LSW]	R	
40195	17th Harmonic	Float [32b-LSW]	R	
40197	18th Harmonic	Float [32b-LSW]	R	
40199	19th Harmonic	Float [32b-LSW]	R	
40201	20th Harmonic	Float [32b-LSW]	R	
40203	21st Harmonic	Float [32b-LSW]	R	
40205	22nd Harmonic	Float [32b-LSW]	R	
40207	23rd Harmonic	Float [32b-LSW]	R	
40209	24th Harmonic	Float [32b-LSW]	R	
40211	25th Harmonic	Float [32b-LSW]	R	
40213	26th Harmonic	Float [32b-LSW]	R	
40215	27th Harmonic	Float [32b-LSW]	R	
40217	28th Harmonic	Float [32b-LSW]	R	
40219	29th Harmonic	Float [32b-LSW]	R	
40221	30th Harmonic	Float [32b-LSW]	R	
40223	31st Harmonic	Float [32b-LSW]	R	
40225	32nd Harmonic	Float [32b-LSW]	R	
40227	33rd Harmonic	Float [32b-LSW]	R	
40229	34th Harmonic	Float [32b-LSW]	R	
40231	35th Harmonic	Float [32b-LSW]	R	
40233	36th Harmonic	Float [32b-LSW]	R	
40235	37th Harmonic	Float [32b-LSW]	R	
40237	38th Harmonic	Float [32b-LSW]	R	
40239	39th Harmonic	Float [32b-LSW]	R	



Address Modbus	Description	Register Type	R/W	Default
40241	40th Harmonic	Float [32b-LSW]	R	
40243	41st Harmonic	Float [32b-LSW]	R	
40245	42nd Harmonic	Float [32b-LSW]	R	
40247	43rd Harmonic	Float [32b-LSW]	R	
40249	44th Harmonic	Float [32b-LSW]	R	
40251	45th Harmonic	Float [32b-LSW]	R	
40253	46th Harmonic	Float [32b-LSW]	R	
40255	47th Harmonic	Float [32b-LSW]	R	
40257	48th Harmonic	Float [32b-LSW]	R	
40259	49th Harmonic	Float [32b-LSW]	R	
40261	50th Harmonic	Float [32b-LSW]	R	
40263	51st Harmonic	Float [32b-LSW]	R	
40265	52nd Harmonic	Float [32b-LSW]	R	
40267	53rd Harmonic	Float [32b-LSW]	R	
40269	54th Harmonic	Float [32b-LSW]	R	
40271	55th Harmonic	Float [32b-LSW]	R	
40273	56th Harmonic	Float [32b-LSW]	R	
40275	57th Harmonic	Float [32b-LSW]	R	
40277	58th Harmonic	Float [32b-LSW]	R	
40279	59th Harmonic	Float [32b-LSW]	R	
40281	60th Harmonic	Float [32b-LSW]	R	
40283	61st Harmonic	Float [32b-LSW]	R	
40285	62nd Harmonic	Float [32b-LSW]	R	
40287	63rd Harmonic	Float [32b-LSW]	R	
40289	Internal Temperature [°C]	Float [32b-LSW]	R	
40291	RTD Temperature [°C]	Float [32b-LSW]	R	
40293	RTD Resistance [Ω]	Float [32b-LSW]	R	
40295	Third wire Resistance [Ω]	Float [32b-LSW]	R	
40297	NTC parallel resistance [Ω]	Float [32b-LSW]	R	
40299	RMS average [A] over “Seconds for average RMS (reg. 40015)”	Float [32b-LSW]	R	
40301	MAX RMS [A] over last “seconds for MAX RMS (reg. 40016)”	Float [32b-LSW]	R	
40303	Min RMS [A] over last “seconds for min RMS (reg. 40017)”	Float [32b-LSW]	R	
40305	DC average [A] over “seconds for average DC (reg. 40018)”	Float [32b-LSW]	R	
40307	MAX DC [A] over last “seconds for MAX DC (reg. 40019)”	Float [32b-LSW]	R	
40309	min DC [A] over last “seconds for min DC (reg. 40020)”	Float [32b-LSW]	R	
40311	AC average [A] over “seconds for average AC (reg. 40021)”	Float [32b-LSW]	R	
40313	MAX AC [A] over last “seconds for MAX AC (reg. 40022)”	Float [32b-LSW]	R	
40315	min AC [A] over last “seconds for min AC (reg. 40023)”	Float [32b-LSW]	R	
40317	Overall Ah for RMS value. Resettable via Command. Optionally storable in flash	Float [32b-LSW]	R	
40319	Overall Ah for DC value. Resettable via Command. Optionally storable in flash	Float [32b-LSW]	R	
40321	Overall Ah for AC value. Resettable via Command. Optionally storable in flash	Float [32b-LSW]	R	
40323	Events' counter of Ah stored in flash (every 20 seconds)	ULong [32b-LSW]	R	
40325	Current peak	Float [32b-LSW]	R/W	
40328	Command: 0xC1C0 = Flash settings save command 0xC1A0 = Reboot command 0xBABA = Load Ah command (Ah to be uploaded must be written reg. 40329) 0xBABB = Load Positive Ah command (positive Ah to be uploaded must be written in reg. 40329) 0xBABC = Load Negative Ah command (negative Ah to be uploaded must be written in reg. 40329) 0xDAAA = Close Switch command 0xDAAB = Open Switch command	UShort [16b]	R/W	
40329	Auxiliary parameter command for reg. 40328	Float [32b-LSW]	R/W	



**LEGEND:**

Short [16b] = Signed Short (16 bit)  
UShort [16b] = Unsigned Short (16 bit)

Long [32b-MSW] = Signed Long (32 bit - MSW First Register)  
Long [32b-LWS] = Signed Long (32 bit - LSW First Register)  
ULong [32b-LSW] = Unsigned Long (32 bit - LSW First Register)  
ULong [32b] = Unsigned Long (32 bit)

Float [32b-MSW] = Float (32 bit - MSW First Register)  
Float [32b-LSW] = Float (32 bit - LSW First Register)

UInt [16b] = Unsigned Integer (16 bit)  
UInt [32b-MSW] = Unsigned Integer (32 bit - MSW First Register)  
Int [64b-LSW] = Signed Long Long (64 bit - LSW First Register)



**D.E.M. SpA**

Zona Ind. Villanova 20  
32013 Longarone (BL)  
ITALIA

[www.dem-it.com](http://www.dem-it.com)  
[www.qeed.it](http://www.qeed.it)

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.